




WATER SERVICE INSTALLATION

The owner's service line must be a minimum of 3/4" diameter. It must be buried at a minimum of 4 1/2'. Approved pipe materials are:

TYPE "K" COPPER - If fittings are used underground, only compression fittings are approved.

HIGH DENSITY POLYETHYLENE PLASTIC PIPE - Rated for 160 PSI or greater, CTS (Copper Tube Size). If fittings are used underground, only compression fittings with stainless steel stiffeners are approved.

CROSS-LINKED POLYETHYLENE (PEX) - Rated for 160 PSI or greater, CTS (Copper Tube Size). If fittings are used underground, only mechanical or compression fittings with insert stiffeners are approved.

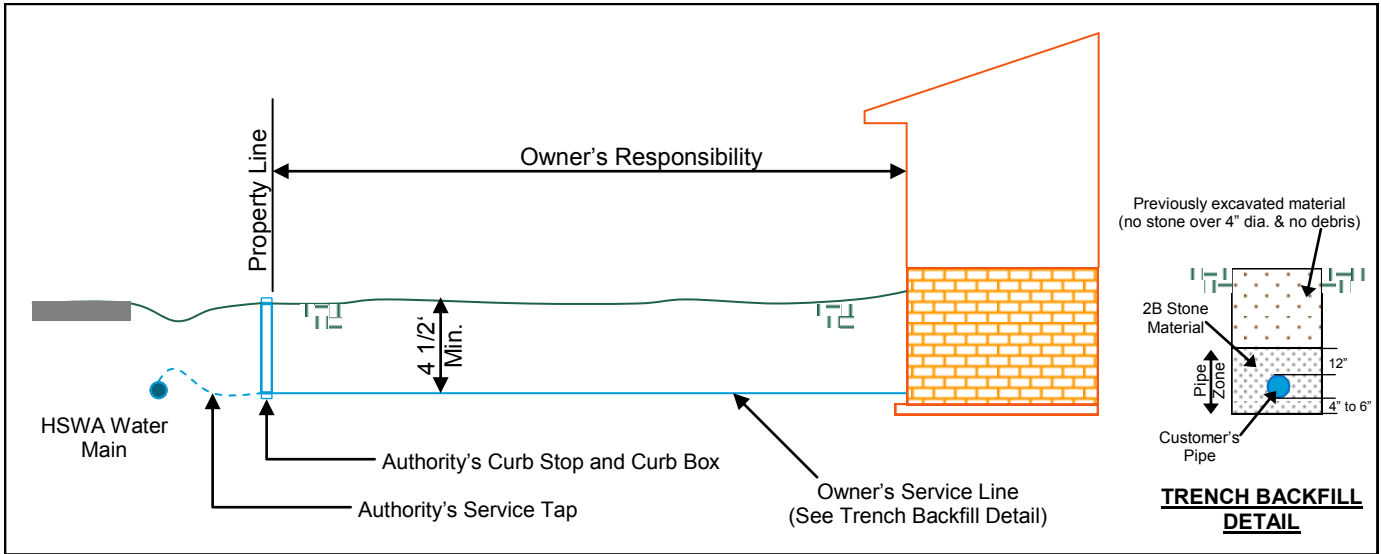

REQUIRED PLUMBING FOR METER INSTALLATION

Coming into the basement from the outside, extend the pipe a minimum of 5" from the wall. Bring the pipe to a horizontal position a minimum of 2' and a maximum of 4' from the floor level, and install as shown below in this order:

- (A) 3/4" shut off valve
- (B) 3/4" Pressure Reducing Valve
- (C) 3/4" x 3/4" F.I.P. adaptor
- (D) 12 1/2" spacer (includes (2) 5/8" x 3/4" meter couplings and 5/8" meter spacer)**
- (C) 3/4" x 3/4" F.I.P. adaptor
- (E) 3/4" Check Valve

Everything in this diagram is the property and maintenance responsibility of the customer with the exception of (D) The Meter Spacer. This may be borrowed from **HIGHLAND** and is replaced by **HIGHLAND'S** water meter.

